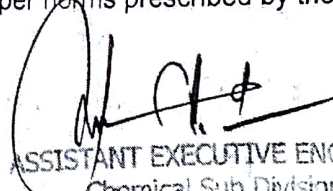


PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. SWTL/CSO/628

Dated: 11/03/26

It is certified that an inspection team headed by Dr. Jan Masood Ahmad Asst. Ex. Engine(Name of Officers with designation) from Jalshakti (PHE) Department Chemical Sub Division Sone(Name of Department/ Office) inspected the Doon School Sonegan(Name & Address of the school) on 17-12-2025 (date of inspection) and found that theDoon School Sonegan (Name of school) has safe drinking water facilities for the students and members of staff of the institution and is maintaining the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/ State/ U.T. Govt.The above is valid for a period of 01 year

 ASSISTANT EXECUTIVE ENGINEER
 Chemical Sub Division

Signature with Seal: Health Engineering Department

Name

Designation

Name & Address of the Office / Department :


To

Principal
Doon School Sonegan

(Name & Address of the Institution)

* The filled up certificate should be either in Hindi or English. If it is issued in vernacular language, translated notarized version in English be uploaded along with the original vernacular certificate as a single pdf.





GOVT. OF JAMMU AND KASHMIR
JAL SHAKTI DEPARTMENT WATER QUALITY MONITORING
STATE WATER TESTING LABORATORY, H.M.T, SRINAGAR.



TC-12766

Test Report

Customer Name & Address	Principal Doon School HMT Opposite Hokarsar Srinagar, Prop:- Showket Hussain Khan	Report No: SWTL/2025/635	Ref. ID:535211955896
		Issued Date: 20/12/2025	Dt:-18-12-2025

Sample Description Details

Quantity: 5000 ml	Source	Tap Water
Sample Id: CSD/PR/B/2025-2026/15/379	Status	Treated Water
W. S. S.: N.A.	Habitation	School Premises at Hokarsar HMT Srinagar.
Sample received on: 17-12-2025	Type of sample	Drinking water
Test Start Date: 17-12-2025	Test End Date:	20-12-2025

Sample Collected By: M. Iqbal (SWTL)


Sample tested as received

Sr. No	Parameters	Units	Test Methods	Results	(Limit as per IS10500:2012)	
					Acceptable Limit	Permissible Limit in the Absence of Alternate Source
1	Calcium	mg/l	IS 3025 (Part 40): 1991 RA 2019 (Titrimetric Method)	50	75	200
2	Chloride	mg/l	IS 3025 (Part 32): 1988 RA 2019 Argentometric Method)	14	250	1000
3	Colour	Hazen units	IS 3025 (Part 4): 2021(Visual Comparison Method)	5	5	15
4	Iron	mg/l	IS 3025 (Part 53):2003 (RA 2019) (Colorimetric Method)	0.00	0.3	1.0
5	Magnesium	mg/l	APHA 24 th Edition -3500-Mg Method B (By Calculation): 2023	22	30	100
6	Odour	-	IS 3025 (Part 5): 2018	Agreeable	Agreeable	Agreeable
7	Ph@25°C	-	IS 3025 (Part 11): 2022(Electrometric Method)	7.8	6.5-8.5	No relaxation
8	Residual Free chlorine	mg/l	IS 3025 (Part 26): 2021(iodometric Method)	0.00	0.2	1.0
9	Sulphate	mg/l	IS 3025 (Part 24): 2019(Gravimetric Method)	100	1	400
10	Taste	-	IS 3025 (Part 8): 2023	Agreeable	Agreeable	Agreeable
11	Total Alkalinity	mg/l	IS 3025 (Part 23): 2019(Titrimetric Method)	100	200	600
12	Total Dissolved Solids	mg/l	IS 3025 (Part 16): 2023(Gravimetric Method)	265	500	2000
13	Total Hardness(as CaCO3)	mg/l	IS 3025 (Part 21): 2009 RA 2019(Titrimetric Method)	216	200	600
14	Turbidity	NTU	IS 3025 (Part 10): 2023(Nephelometric Method)	0.1	1	5

Reviewed By:

Authorised Signatory
Dr. Jan Masood Ahmad

- The test report and result relate to the specimen/ sample (s) of the material as delivered /received and tested in the laboratory
- This test report shall not be reproduced in part, without the permission of this laboratory.
- Any correction invalidates this test reports.
- WQC lab always strives to provide accurate and reliable for all customers. However, it is not responsible for any financial/legal liability arising



GOVT. OF JAMMU AND KASHMIR
JAL SHAKTI DEPARTMENT WATER QUALITY MONITORING
STATE WATER TESTING LABORATORY, H.M.T, SRINAGAR.



Sample Id:- CSD/PR/B/2025-2026-15-179

Test methods adopted:- BIS 3025, I.P.A.50, IS 150-1, Spectrophot & Spectrophotometer

Report:-


Sr. No	Parameters	Units	Results	B.I.S 10500 of 2012 guidelines	
				Acceptable Limit	Permissible Limit in the Absence of Alternate Source
1	Conductivity at 25 °C	µs/cm	379	-	-
2	Fluorides (as F)	mg/l	0.35	1.0	1.5
3	Total Acidity	mg/l	10	--	--
4	Ammonical Nitrogen(NH ₃ N)	mg/l	0.00	0.1	0.5
5	Nitrites (as NO ₂ ⁻)	mg/l	---	None	Traces
6	Nitrate Nitrogen (NO ₃ N)	mg/l	0.00	45	45
7	Total Phosphate (as PO ₄)	mg/l	0.00	0.4	5.0
8	Carbon Dioxide	mg/l	4.0	--	--
9	Dissolved Oxygen	mg/l	---	≥4.0	≤10.0
10	Arsenic	mg/l	---	0.05	0.05
11	Cadmium	mg/l	---	0.01	0.01
12	Copper	mg/l	---	0.05	1.5
13	Lead	mg/l	---	0.1	0.1
14	Chromium	mg/l	----	0.05	0.05
15	Cyanide	mg/l	----	0.05	0.05
16	Phenolic compounds	mg/l	---	0.001	0.005
17	Coliform Organism	-	Negative(-ve)	Negative	Negative

Reviewed By

Authorised Signatory
Dr. Jan Masood Ahmad

Note:

- The test report and result relate to the specimen/ sample (s) of the material as delivered /received and tested in the laboratory.
- This test report shall not be reproduced in part, without the permission of this laboratory.
- Any correction invalidates this test reports.
- WQC lab always strives to provide accurate and reliable for all customers. However, it is not responsible for any financial/legal liability arising out of any errors or omissions. Refer to terms & Conditions of reports overleaf.
- Sample should be retained for 15 days only.



GOVT. OF JAMMU AND KASHMIR
JAL SHAKTI DEPARTMENT WATER QUALITY MONITORING
STATE WATER TESTING LABORATORY J.M.T. SRINAGAR



TC-12766

Test Report

Customer Name & Address	Principal Doon School HMT Opposite Hokarsar Srinagar. Prop:- Showket Hussain Khan	Report No: SWTL/2025/636	Ref. ID:535211955896 Dt:-18-12-2025
		Issued Date: 20/12/2025	

Sample Description Details

Quantity: 5000 ml	Source	Tap Water
Sample Id: CSD/PR/B/2025-2026/15/380	Status	Treated through R.O
W/S/S:	N.A.	Habitation
Sample received on	17-12-2025	Type of sample
Test Start Date:	17-12-2025	Test End Date:
		20-12-2025

Sample Collected By: M. Iqbal (SWTL)

Sample tested as received

Sr. No	Parameters	Units	Test Methods	Results	(Limit as per IS10500:2012)	
					Acceptable Limit	Permissible Limit in the Absence of Alternate Source
1	Calcium	mg/l	IS 3025 (Part 40): 1991 RA 2019 (Titrimetric Method)	47	75	200
2	Chloride	mg/l	IS 3025 (Part 32): 1988 RA 2019 Argentometric Method)	13	250	1000
3	Colour	Hazen units	IS 3025 (Part 4): 2021(Visual Comparison Method)	5	5	15
4	Iron	mg/l	IS 3025 (Part 53):2003 (RA 2019) (Colorimetric Method)	0.00	0.3	1.0
5	Magnesium	mg/l	APHA 24 th Edition -3500-Mg Method B (By Calculation): 2023	21	30	100
6	Odour	-	IS 3025 (Part 5): 2018	Agreeable	Agreeable	Agreeable
7	Ph@25°C	-	IS 3025 (Part 11): 2022(Electrometric Method)	7.6	6.5-8.5	No relaxation
8	Residual Free chlorine	mg/l	IS 3025 (Part 26): 2021(iodometric Method)	0.00	0.2	1.0
9	Sulphate	mg/l	IS 3025 (Part 24): 2019(Gravimetric Method)	100	1	400
10	Taste	-	IS 3025 (Part 8): 2023	Agreeable	Agreeable	Agreeable
11	Total Alkalinity	mg/l	IS 3025 (Part 23): 2019(Titrimetric Method)	100	200	600
12	Total Dissolved Solids	mg/l	IS 3025 (Part 16): 2023(Gravimetric Method)	260	500	2000
13	Total Hardness(as CaCO ₃)	mg/l	IS 3025 (Part 21): 2009 RA 2019(Titrimetric Method)	206	200	600
14	Turbidity	NTU	IS 3025 (Part 10): 2023(Nephelometric Method)	5.8	1	5

Reviewed By:

Authorised Signatory
Dr. Jan Masood Ahmad

Note

- The test report and result relate to the specimen/ sample (s) of the material as delivered /received and tested in the laboratory
- This test report shall not be reproduced in part, without the permission of this laboratory.
- Any correction invalidates this test reports.
- WQC lab always strives to provide accurate and reliable for all customers. However, it is not responsible for any financial/legal liability arising out of any errors or omissions. Refer to terms & Conditions of reports, if available.
- Sample should be retained for 15 days only



GOVT. OF JAMMU AND KASHMIR
JAL SHAKTI DEPARTMENT WATER QUALITY MONITORING
STATE WATER TESTING LABORATORY, H.M.T, SRINAGAR.



Sample Id:- CSD/PR/B/2025-2026/15/380

Test methods adopted:- BIS-3025, EPA350, IS7150-1, Spectroquant & Spectrophotometer

Report:-

Sr. No	Parameters	Units	Results	B.I.S 10500 of 2012 guidelines	
				Acceptable Limit	Permissible Limit in the Absence of Alternate Source
1	Conductivity at 25 °C	µs/cm	372	-	-
2	Fluorides (as F)	mg/l	0.35	1.0	1.5
3	Total Acidity	mg/l	10	--	--
4	Ammonical Nitrogen(NH ₃ N)	mg/l	0.00	0.1	0.5
5	Nitrites (as NO ₂)	mg/l	---	None	Traces
6	Nitrate Nitrogen (NO ₃ N)	mg/l	0.00	45	45
7	Total Phosphate (as PO ₄)	mg/l	0.00	0.4	5.0
8	Carbon Dioxide	mg/l	4.0	--	--
9	Dissolved Oxygen	mg/l	---	≥4.0	≤10.0
10	Arsenic	mg/l	---	0.05	0.05
11	Cadmium	mg/l	---	0.01	0.01
12	Copper	mg/l	---	0.05	1.5
13	Lead	mg/l	---	0.1	0.1
14	Chromium	mg/l	----	0.05	0.05
15	cyanide	mg/l	----	0.05	0.05
16	Phenolic compounds	mg/l	---	0.001	0.005
17	Coliform Organism	-	Negative(-ve)	Negative	Negative

Reviewed By

Authorised Signatory
Dr. Jan Masood Ahmad

Note

- The test report and result relate to the specimen/ sample (s) of the material as delivered /received and tested in the laboratory.
- This test report shall not be reproduced in part, without the permission of this laboratory.
- Any correction invalidates this test reports.
- WQC lab always strives to provide accurate and reliable for all customers. However, it is not responsible for any financial/legal liability arising out of any errors or omissions. Refer to terms & Conditions of reports overleaf.
- Sample should be retained for 15 days only.

*****End of Report*****